Installation Instructions for Scout Vertical

Models SCT-VRXX-XX

Please read all instructions prior to installation and keep for future reference!


FOR REMOTE POWER SUPPLY INSTALLATION (CLASS 2)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. USE ONLY WITH CLASS 2 POWER UNIT.
4. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE.
5. SUITABLE FOR DAMP LOCATIONS.
6. 24 VOLTS DC.

FOR INTEGRAL POWER SUPPLY INSTALLATION (CLASS 1)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. MIN 60°C SUPPLY CONDUCTORS.
4. SUITABLE FOR DAMP LOCATIONS
5. CLASS 1 WIRING ONLY.
6. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE

luminii
7777 N. Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

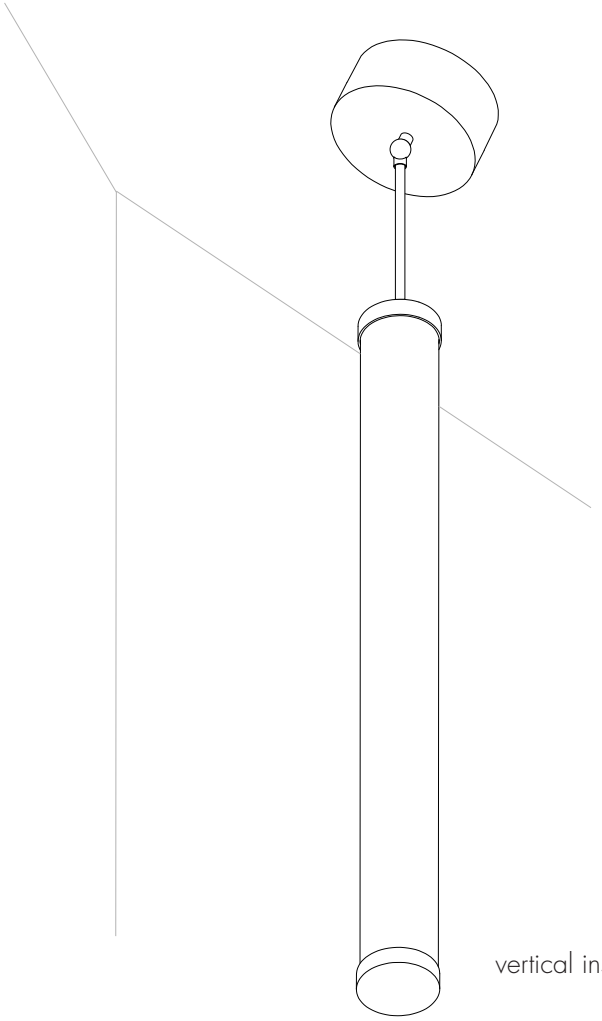

vertical installation

IMPORTANT SAFETY INSTRUCTIONS!
WHEN INSTALLING OR USING THIS TRACK SYSTEM, BASIC SAFETY PRECAUTIONS SHOULD ALWAYS BE FOLLOWED, INCLUDING:

A. READ ALL INSTRUCTIONS

B. DO NOT INSTALL ANY PART OF THE TRACK SYSTEM LESS THAN 5 FEET ABOVE THE FLOOR

C. DO NOT INSTAL ANY LUMINAIRE ASSEMBLY CLOSER THAN 6 INCHES FROM ANY CURTAIN OR SIMILARCOMBUSTIBLE MATERIAL

D. DISCONNECT ELECTRICAL POWER BEFORE ADDING TO OR CHANGING THE CONFIGURATION OF THE TRACK

E. DO NOT ATTEMPT TO ENERGIZE ANYTHING OTHER THAN LIGHTING TRACK LUMINARES ON THE TRACK. TO REDUCE THE RISL OF FIRE AND ELECTRIC SHOCK, DO NOT ATTEMPT TO CONNECT POWER TOOLS, EXTENSION CORDS, APPLIANCE, OR THE LIKE TO THE TRACK.

Installation Instructions for Scout Vertical

Models SCT-VRXX-XX

Please read all instructions prior to installation and keep for future reference!

FOR REMOTE POWER SUPPLY INSTALLATION (CLASS 2)


1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. USE ONLY WITH CLASS 2 POWER UNIT.
4. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE.
5. SUITABLE FOR DAMP LOCATIONS.
6. 24 VOLTS DC.

luminii
7777 N. Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

FOR INTEGRAL POWER SUPPLY INSTALLATION (CLASS 1)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. MIN 60°C SUPPLY CONDUCTORS.
4. SUITABLE FOR DAMP LOCATIONS
5. CLASS 1 WIRING ONLY.
6. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE

1

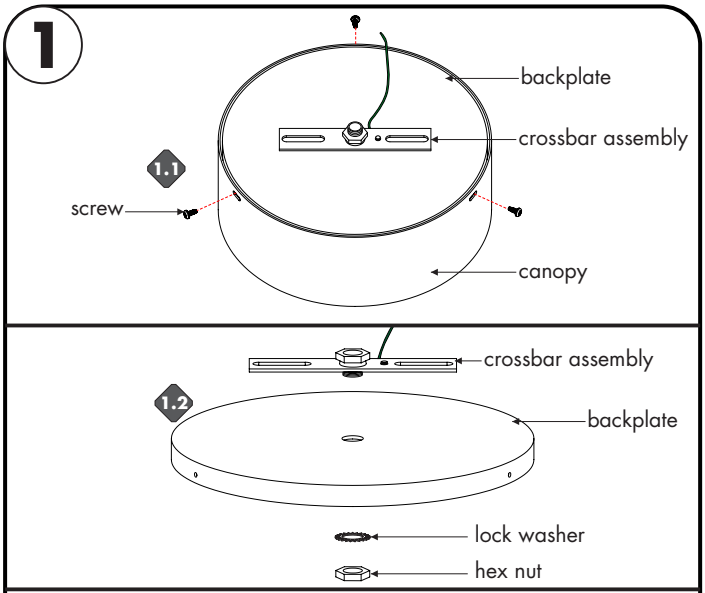


Note: **More than one person is recommended for this install.**

1.1 Carefully, place canopy on a flat surface, and remove the 3 screws from the canopy. Take the backplate off completely.


1.2 Remove the crossbar assembly from the backplate.

2

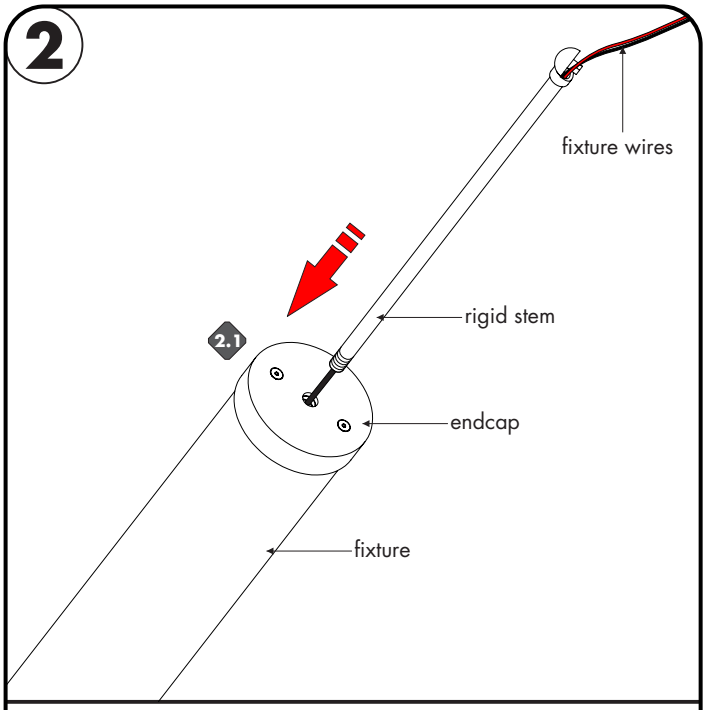


2.1 Feed the fixture wires through the rigid stem, then tighten to secure into the endcap.

3

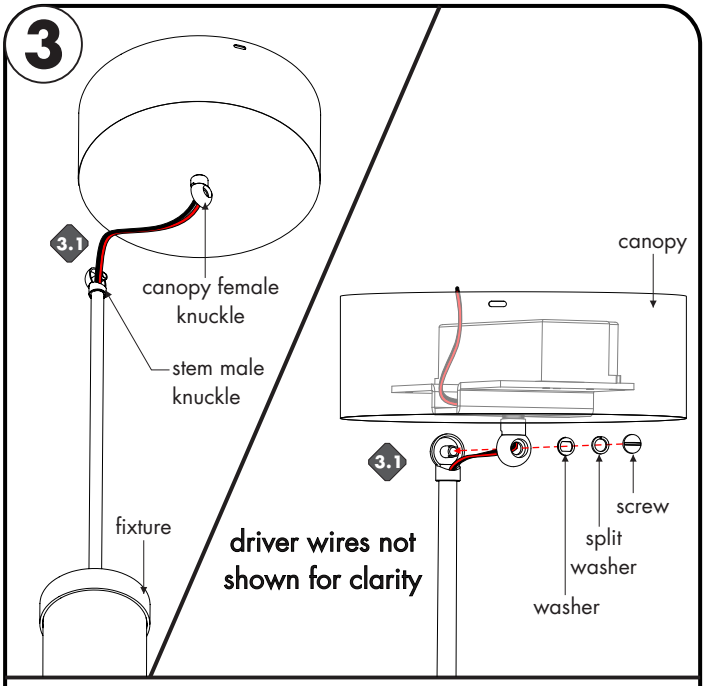

3.1 Align the canopy female knuckle to the stem male knuckle and feed the fixture wires through into the canopy. Followed by securing together, reference diagram above to secure.

4

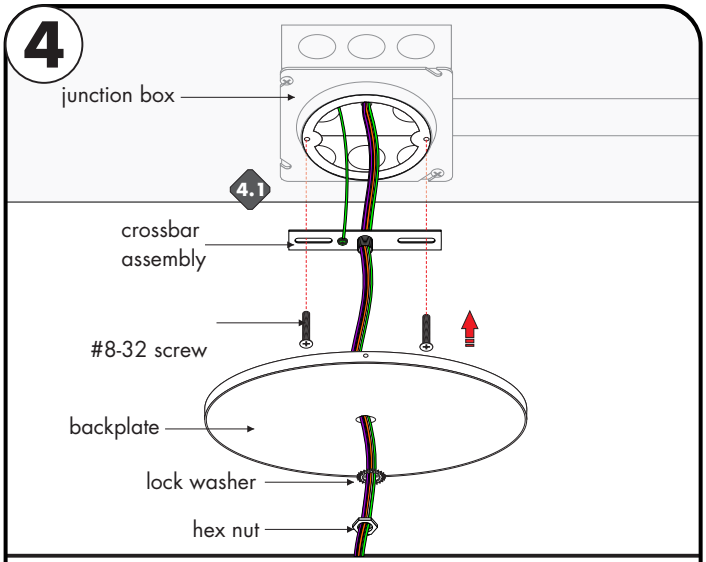

4.1 Insert the power wires into the crossbar assembly, backplate, lock washer and hex nut.

4.1 Align the crossbar assembly to the junction box holes and secure using the provided two #8-32 screw.

4.2 Slide the backplate up to the crossbar and secure by tightening the lock washer & hex nut into the crossbar nipple.

*LUMINII RESERVES THE RIGHTS TO CHANGE SPECIFICATION & INSTRUCTION WITHOUT NOTICE

Installation Instructions for Scout Vertical

Models SCT-VRXX-XX

Please read all instructions prior to installation and keep for future reference!

FOR REMOTE POWER SUPPLY INSTALLATION (CLASS 2)


1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. USE ONLY WITH CLASS 2 POWER UNIT.
4. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE.
5. SUITABLE FOR DAMP LOCATIONS.
6. 24 VOLTS DC.

FOR INTEGRAL POWER SUPPLY INSTALLATION (CLASS 1)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. MIN 60°C SUPPLY CONDUCTORS.
4. SUITABLE FOR DAMP LOCATIONS
5. CLASS 1 WIRING ONLY.
6. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE

luminii
7777 N. Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com


5

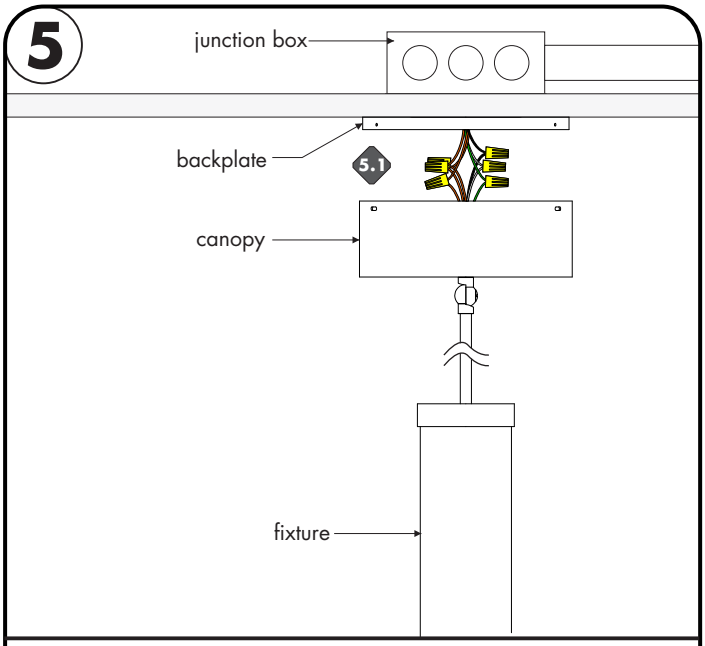

5.1 Refer to the wiring diagram on page 4 and make all necessary connections from the power wires to the canopy driver wires.


5.2 Connect to ground in accordance with local electrical codes.

6

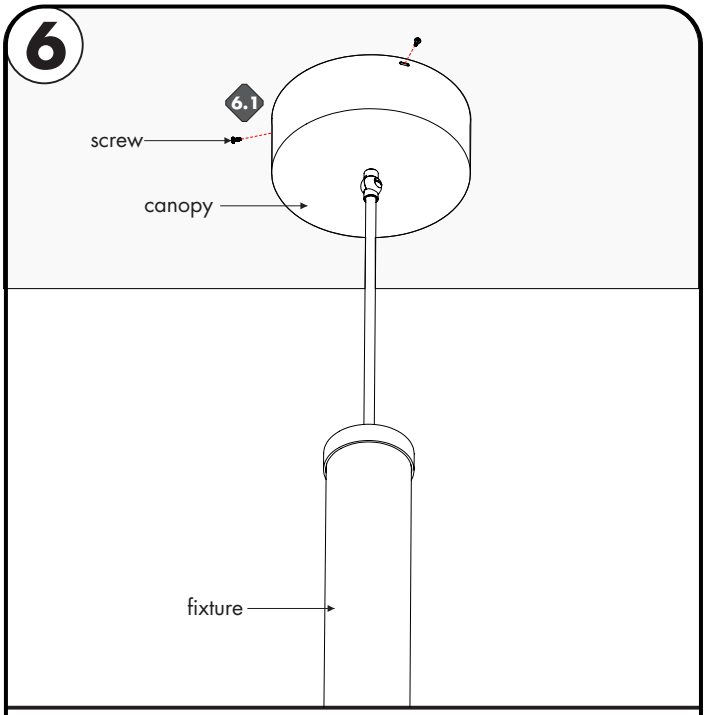

6.1 Insert the wire nut connections into the canopy. Align the canopy to the backplate and securing using the 3 screws.

7

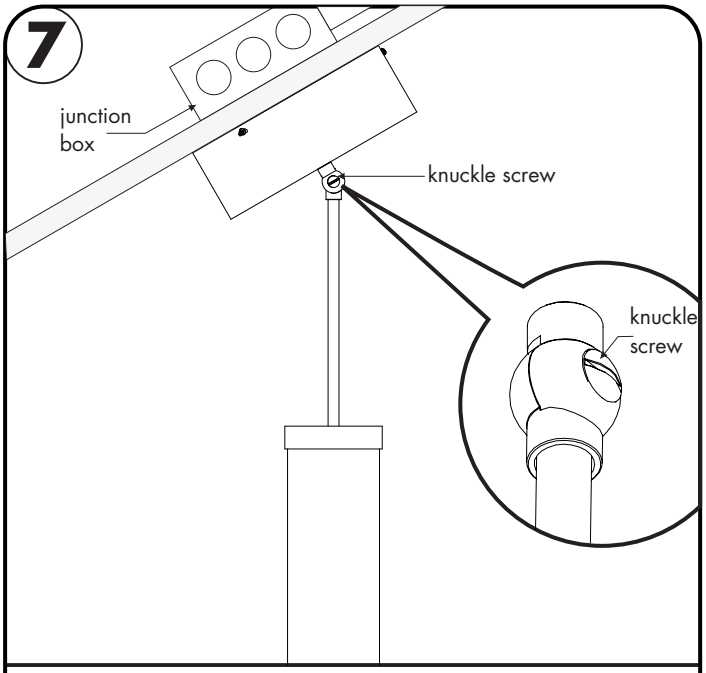

7.1 If installed to a slanted ceiling, slightly loosen knuckle screw. Then rotate fixture stem, until fixture straight. Then re-tighten the screw secure.

*LUMINII RESERVES THE RIGHTS TO CHANGE SPECIFICATION & INSTRUCTION WITHOUT NOTICE

Installation Instructions for Scout Vertical

Models SCT-VRXX-XX

Please read all instructions prior to installation and keep for future reference!

FOR REMOTE POWER SUPPLY INSTALLATION (CLASS 2)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. USE ONLY WITH CLASS 2 POWER UNIT.
4. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE.
5. SUITABLE FOR DAMP LOCATIONS.
6. 24 VOLTS DC.

FOR INTEGRAL POWER SUPPLY INSTALLATION (CLASS 1)

1. PRODUCT TO BE INSTALLED BY A QUALIFIED ELECTRICIAN.
2. PRIOR TO INSTALLATION ENSURE POWER IS OFF AT FUSE BOX TO PREVENT ELECTRICAL SHOCK.
3. MIN 60°C SUPPLY CONDUCTORS.
4. SUITABLE FOR DAMP LOCATIONS
5. CLASS 1 WIRING ONLY.
6. FIXTURE SHOULD BE INSTALLED BY TWO PEOPLE

luminii
7777 N. Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

Power Supply Wiring Diagram

Note: *Prior to installation all 24VDC wires must be present near fixture. Refer to the power supply installation instructions for additional information.*

Static White
Wiring Diagram PDF